


# Three Zones with Pre-Plumbed Two Zone Cylinder

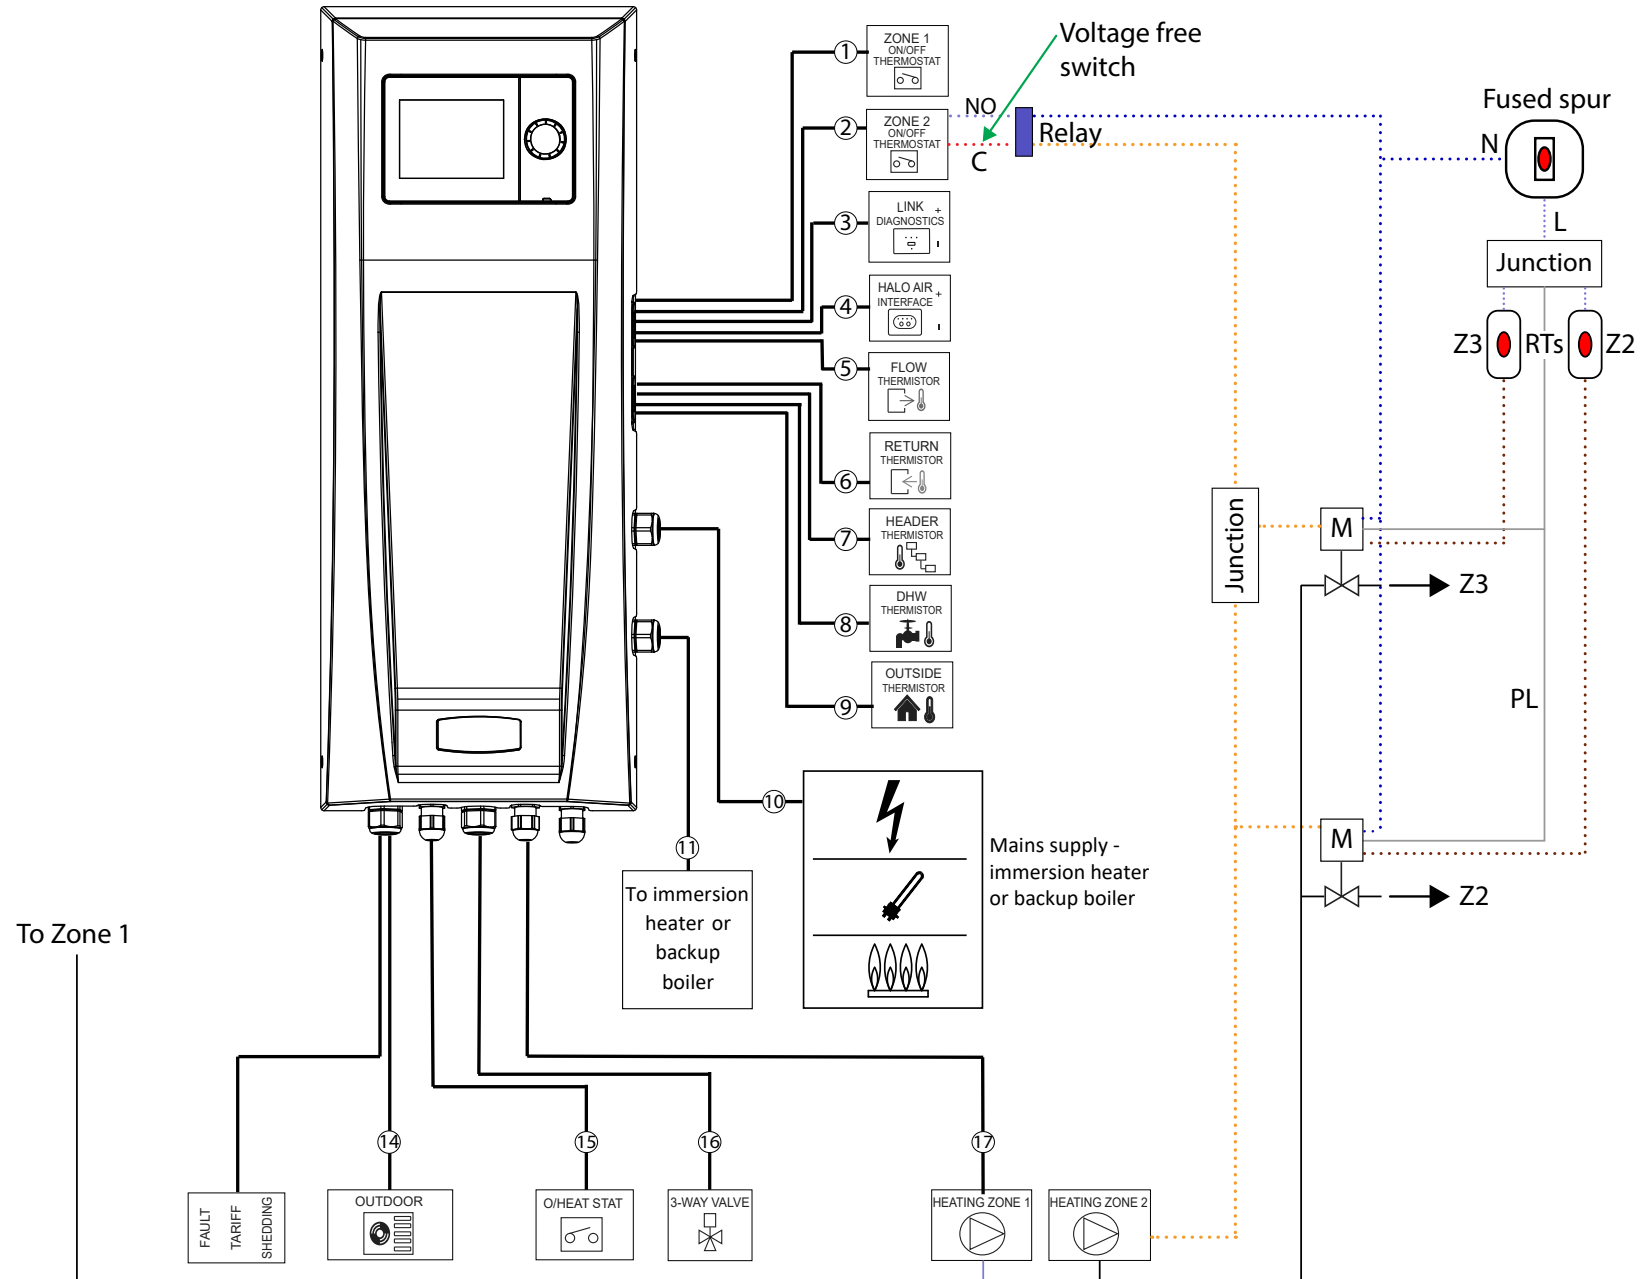


The wiring for the heating zone two pump is to be disconnected from the control box, as it is supplied via the zone valves.

Three zone system on our two zone pre-plumbed cylinder requirements:-

1. Must use the integral buffer cylinder
- or
2. If using LLH for separation, zone 1 must have the minimum free volume for defrost.

## Wiring

Note: Zone two ON/OFF thermostat connection is volt free.

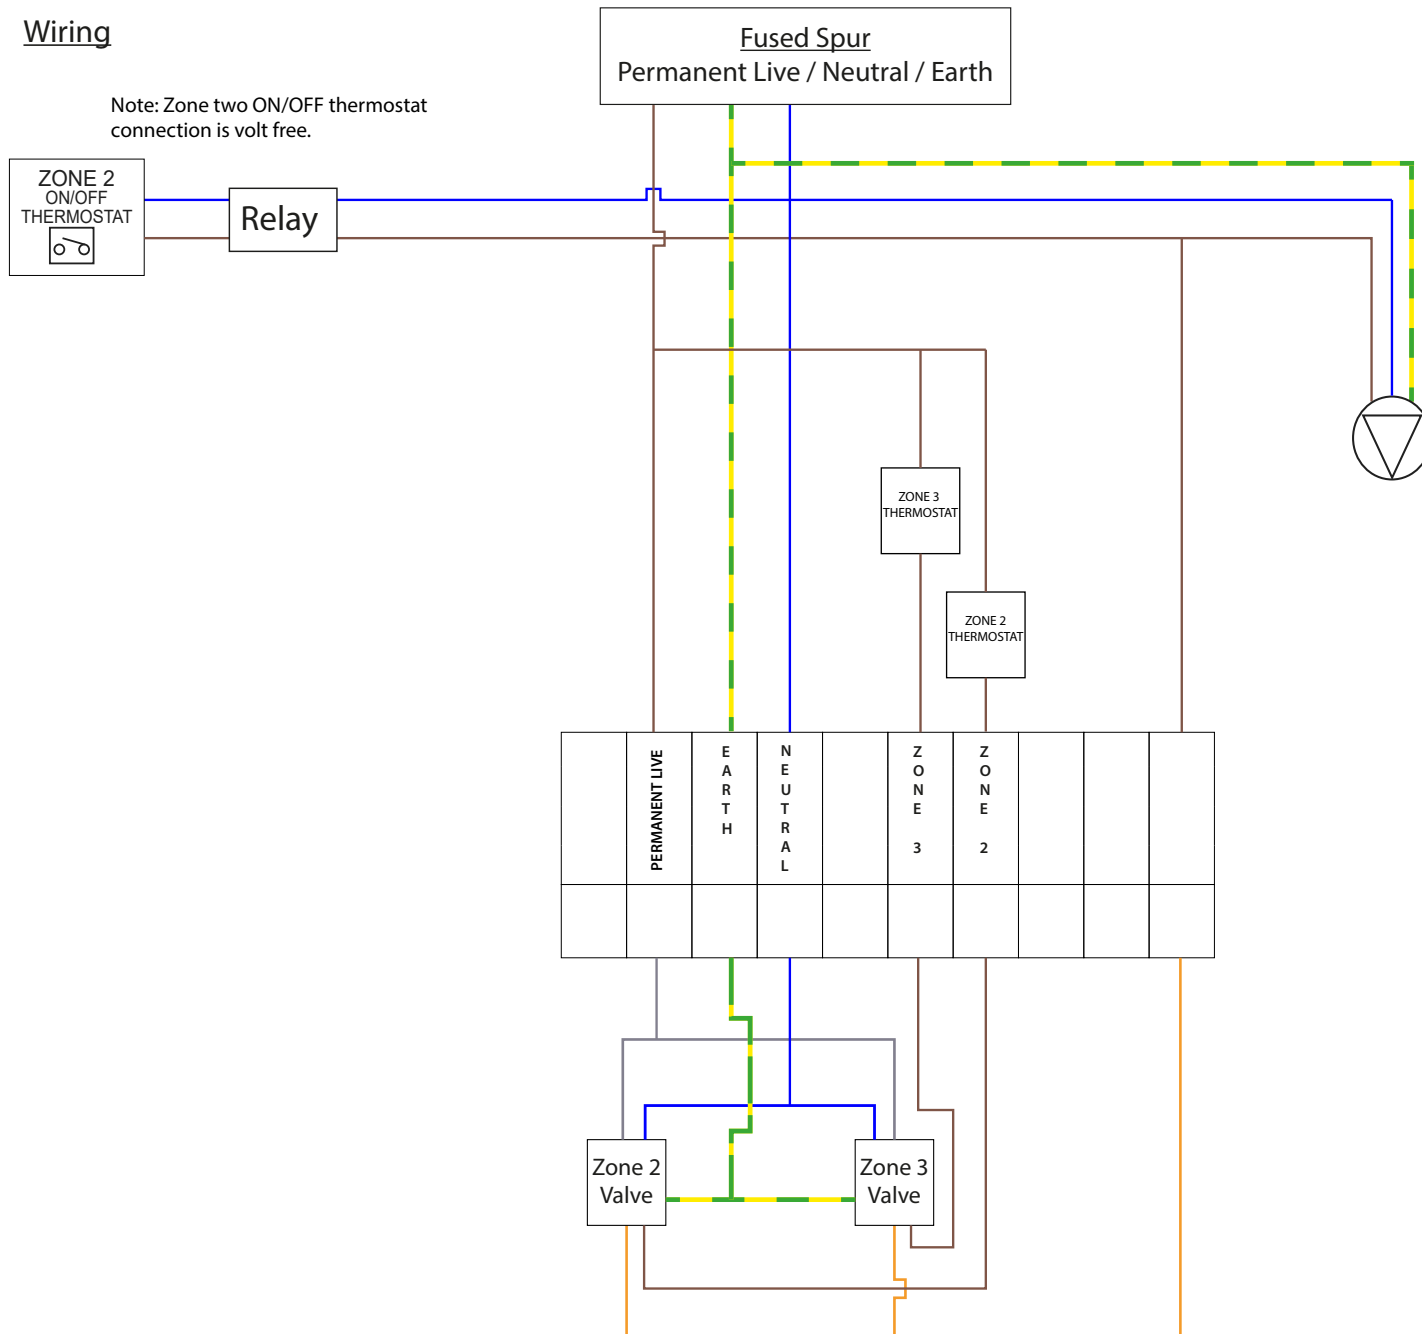

## Hydraulics

